


NOTES:

1. THIS IS A TYPICAL EXAMPLE. INSTALLATION VARIES ACCORDING TO THE SERVICE PROVIDED.
2. ALL CONDUIT SHALL BE SCHEDULE 40 PVC MIN.
3. CONDUIT SHALL BE GRAY IN COLOR.
4. PROVIDE PLAN LAYOUT AND JOINT USE TRENCH DETAIL WITH ALL UTILITY APPROVALS PRIOR TO INSTALLATION.

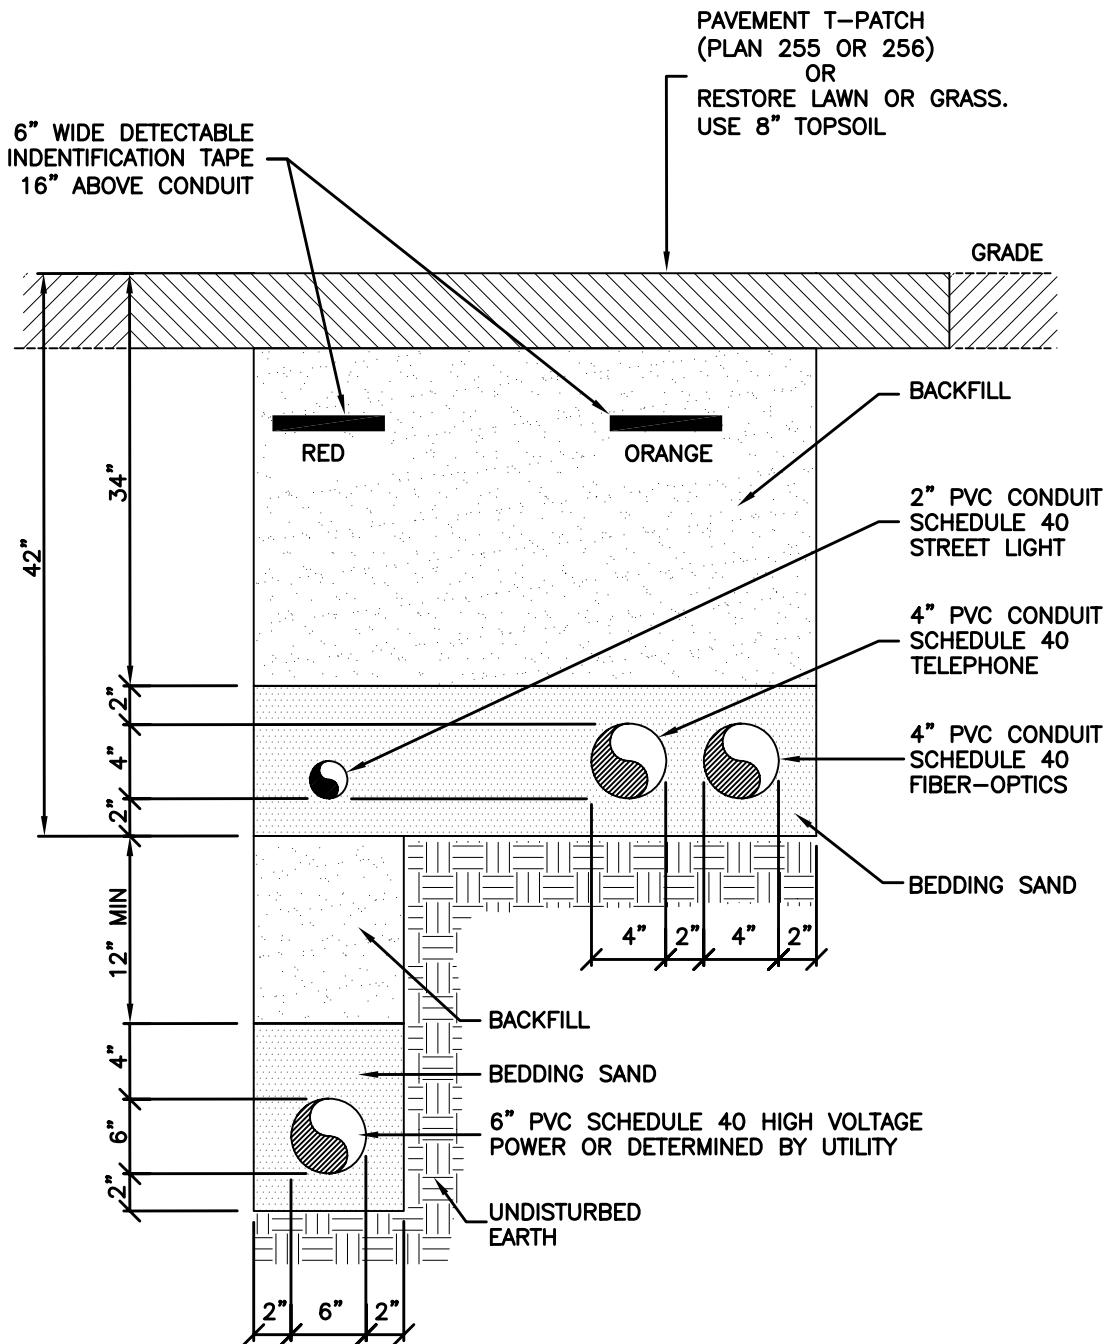

Joint use trench