

CONDITION "A"

PARKING ADJACENT TO SIDEWALK OR LOW LEVEL LANDSCAPE AREA WHICH ALLOWS OVERHANG OF VEHICLE.
 MINIMUM PARKING STALL LENGTH 18-FOOT.
 ADJACENT SIDEWALK MUST BE 6-FOOT MINIMUM.

CONDITION "B"

END TO END PARKING
 MINIMUM PARKING STALL LENGTH 20-FOOT.

CONDITION "C"

PARKING ADJACENT TO WALL OR OTHER SOLID OBSTACLE.
 MINIMUM PARKING STALL LENGTH 20-FOOT.

GENERAL NOTES:

MINIMUM STALL LENGTH SHALL BE BASED UPON PARKING CONDITION SHOWN, ABOVE.

MINIMUM STALL WIDTH SHALL BE 9-FOOT.


THE NUMBER OF ACCESSIBLE PARKING STALLS REQUIRED SHALL BE PROVIDED PER FEDERAL GUIDELINES.

- * MINIMUM AISLE WIDTH SHALL BE 24-FOOT. FIRE DEPT. MAY REQUIRE ADDITIONAL FOR FIRE ACCESS ROADS.

PARKING LOT DESIGN STANDARDS



PARKING LOT LAYOUT (90°)

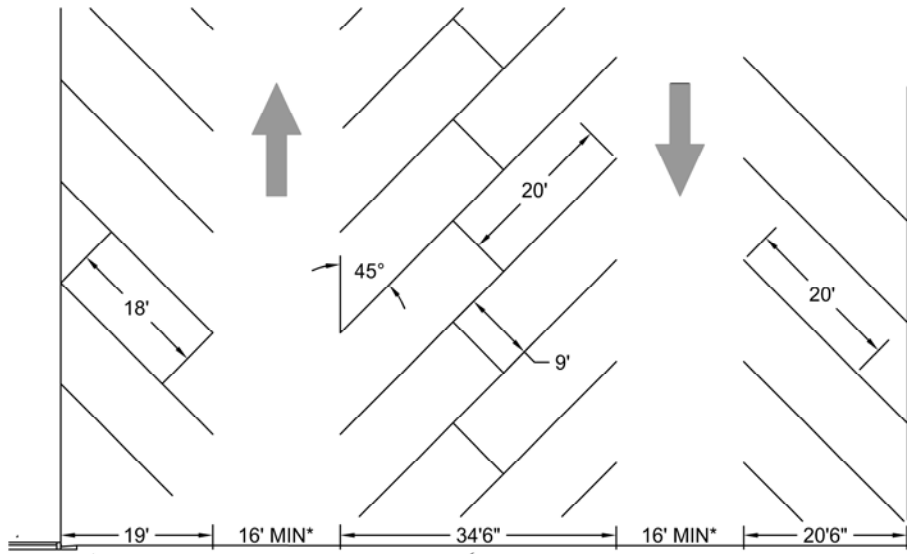

CONDITION "A"

PARKING ADJACENT TO SIDEWALK OR LOW LEVEL LANDSCAPE AREA WHICH ALLOWS OVERHANG OF VEHICLE.

MINIMUM PARKING STALL LENGTH 18-FOOT.

ADJACENT SIDEWALK MUST BE 6-FOOT MINIMUM.

CONDITION "B"

END TO END PARKING

MINIMUM PARKING STALL LENGTH 20-FOOT.

CONDITION "C"

PARKING ADJACENT TO WALL OR OTHER SOLID OBSTACLE.

MINIMUM PARKING STALL LENGTH 20-FOOT.

GENERAL NOTES:


MINIMUM STALL LENGTH SHALL BE BASED UPON PARKING CONDITION SHOWN, ABOVE.

MINIMUM STALL WIDTH SHALL BE 9-FOOT.

THE NUMBER OF ACCESSIBLE PARKING STALLS REQUIRED SHALL BE PROVIDED PER FEDERAL GUIDELINES.

- * MINIMUM ONE-WAY AISLE WIDTH SHALL BE 16-FOOT. FIRE DEPT. MAY REQUIRE ADDITIONAL FOR FIRE ACCESS ROADS.

PARKING LOT DESIGN STANDARDS

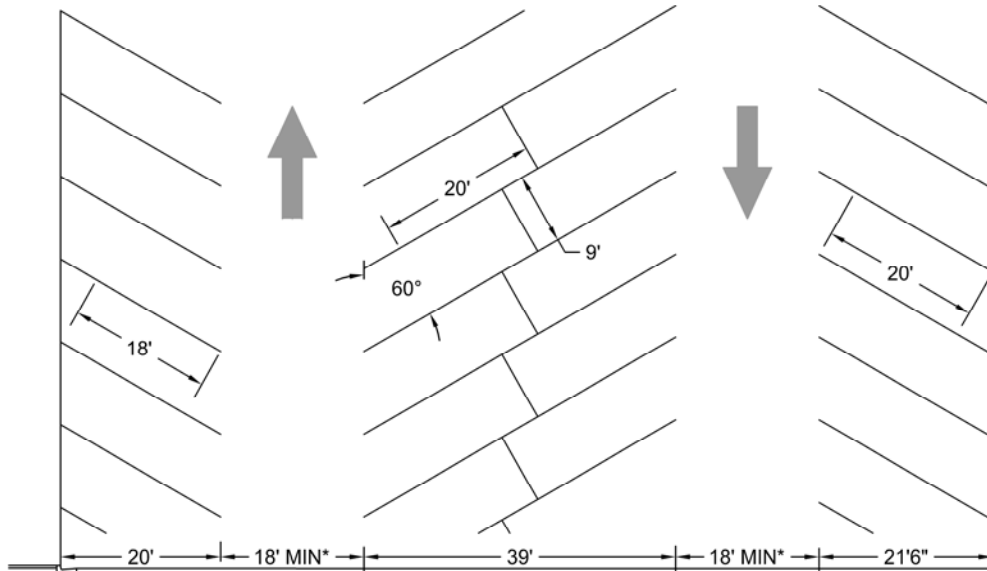

CONDITION "A"

PARKING ADJACENT TO SIDEWALK OR LOW LEVEL LANDSCAPE AREA WHICH ALLOWS OVERHANG OF VEHICLE.

MINIMUM PARKING STALL LENGTH 18-FOOT.

ADJACENT SIDEWALK MUST BE 6-FOOT MINIMUM.

CONDITION "B"

END TO END PARKING

MINIMUM PARKING STALL LENGTH 20-FOOT.

CONDITION "C"

PARKING ADJACENT TO WALL OR OTHER SOLID OBSTACLE.

MINIMUM PARKING STALL LENGTH 20-FOOT.

GENERAL NOTES:

MINIMUM STALL LENGTH SHALL BE BASED UPON PARKING CONDITION SHOWN, ABOVE.

MINIMUM STALL WIDTH SHALL BE 9-FOOT.

THE NUMBER OF ACCESSIBLE PARKING STALLS REQUIRED SHALL BE PROVIDED PER FEDERAL GUIDELINES.

- * MINIMUM ONE WAY AISLE WIDTH SHALL BE 18-FOOT. FIRE DEPT. MAY REQUIRE ADDITIONAL FOR FIRE ACCESS ROADS.

PARKING LOT DESIGN STANDARDS